

JTEC Environmental Ltd.

Asbestos Survey for

Hall & Woodhouse Ltd

at

Barford Inn,
Grovely Road
Barford St Martin
Salisbury
Wiltshire
SP3 4AB



Project Number: AS05011 - Barford inn

Printed: 02/11/2008 By: JTEC Environmental Ltd.. Using Multibase software.



JTEC Environmental Ltd.

Names and Addresses

Client Name:

Hall & Woodhouse Ltd

The Brewery
Blandford St Mary
Dorset
DT11 9LS

Contact:

Phone: 01258 452141

Fax:

Instructing Party:

Hall & Woodhouse Ltd

The Brewery
Blandford St Mary
Dorset
DT11 9LS

Contact:

Phone: 01258 452141

Fax:

Site Full Name:

Barford Inn,
Grovely Road
Barford St Martin
Salisbury
Wiltshire
SP3 4AB

Contact:

Phone:

Fax:

Report Author:

JTEC Environmental Ltd.
Tansley Cottage, Shave Lane,
Todber,
Sturminster Newton,
Dorset.
DT10 1JA

Contact: John Chilvers
Surveyor

Phone: 01258 821398

Fax: 01258 821398

<i>JTEC Environmental Ltd.</i>	Project Number:	AS05011 - Barford inn
	Survey Date:	17 January 2005
	Printed On:	02 November 2008
	Page:	Page 1 of 1

TABLE OF CONTENTS

SECTION 1	Site Description
SECTION 2	Survey Drawings
SECTION 3	Survey Objectives
SECTION 4	Survey Techniques
SECTION 5	Survey Caveat
SECTION 6	Survey Notes
SECTION 7	Survey Summary
SECTION 8	Survey Recommendations
SECTION 9	Material Assessment: Summary by Area
SECTION 10	Material Assessment (Photo)
SECTION 11	Bulk Identification Report
SECTION 12	Priority Assessment: Summary by Area
SECTION 13	Priority Assessment (Photo)
SECTION 14	Excluded Areas

SECTION ONE

SITE DESCRIPTION

JTEC Environmental Ltd.

Site Description

General Information:


The original part of this building dates back several hundred years. A number of refurbishment works have been carried out through time and the building has also been extended.
Samples taken reveal large amounts of AIB and the likelihood is that there may be further ACM's which are inaccessible without destructive sampling.

Area	Comments	Accessed
Main building	Samples taken & presumed asbestos materials present, asbestos materials present in samples.	Yes
Annexe / Letting rooms	Samples taken & presumed asbestos materials present, asbestos materials present in samples.	Yes

Client Name:	Hall & Woodhouse Ltd	Project Number:	AS05011 - Barford inn
		Survey Date:	17 January 2005
Site Address:	Barford Inn,. Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Printed On:	02 November 2008
		Site Description:	Page 1 of 1

SECTION TWO


SURVEY DRAWINGS

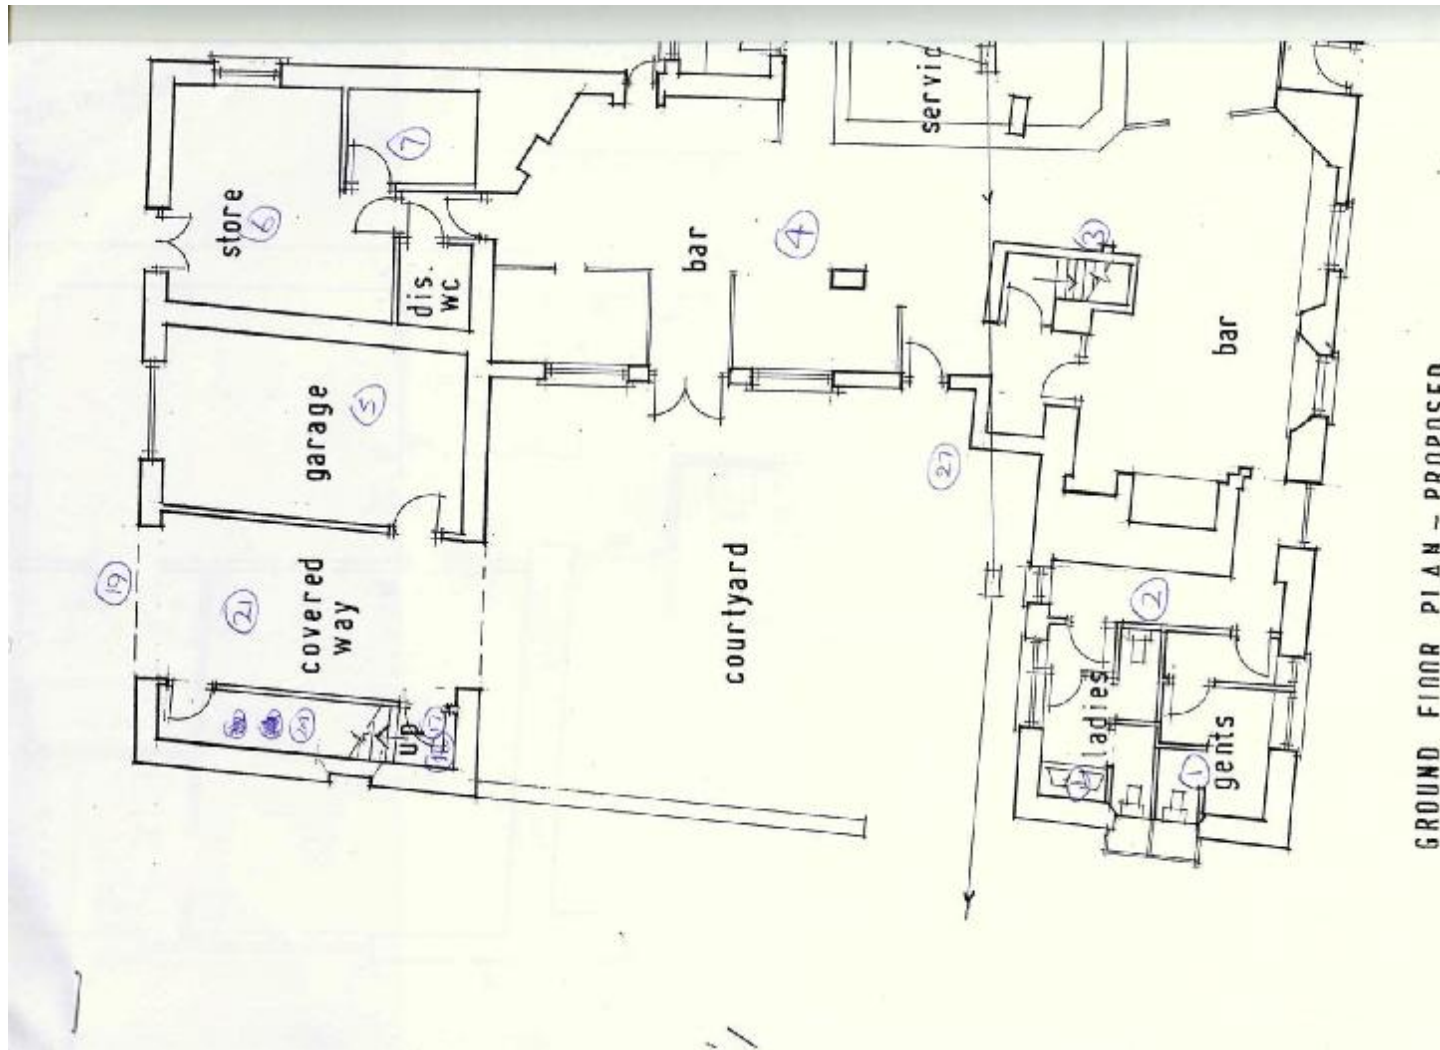

Description of Drawing:
Ground floor layout 1

Survey Drawings and Documentation


Project Number: AS05011 - Barford inn

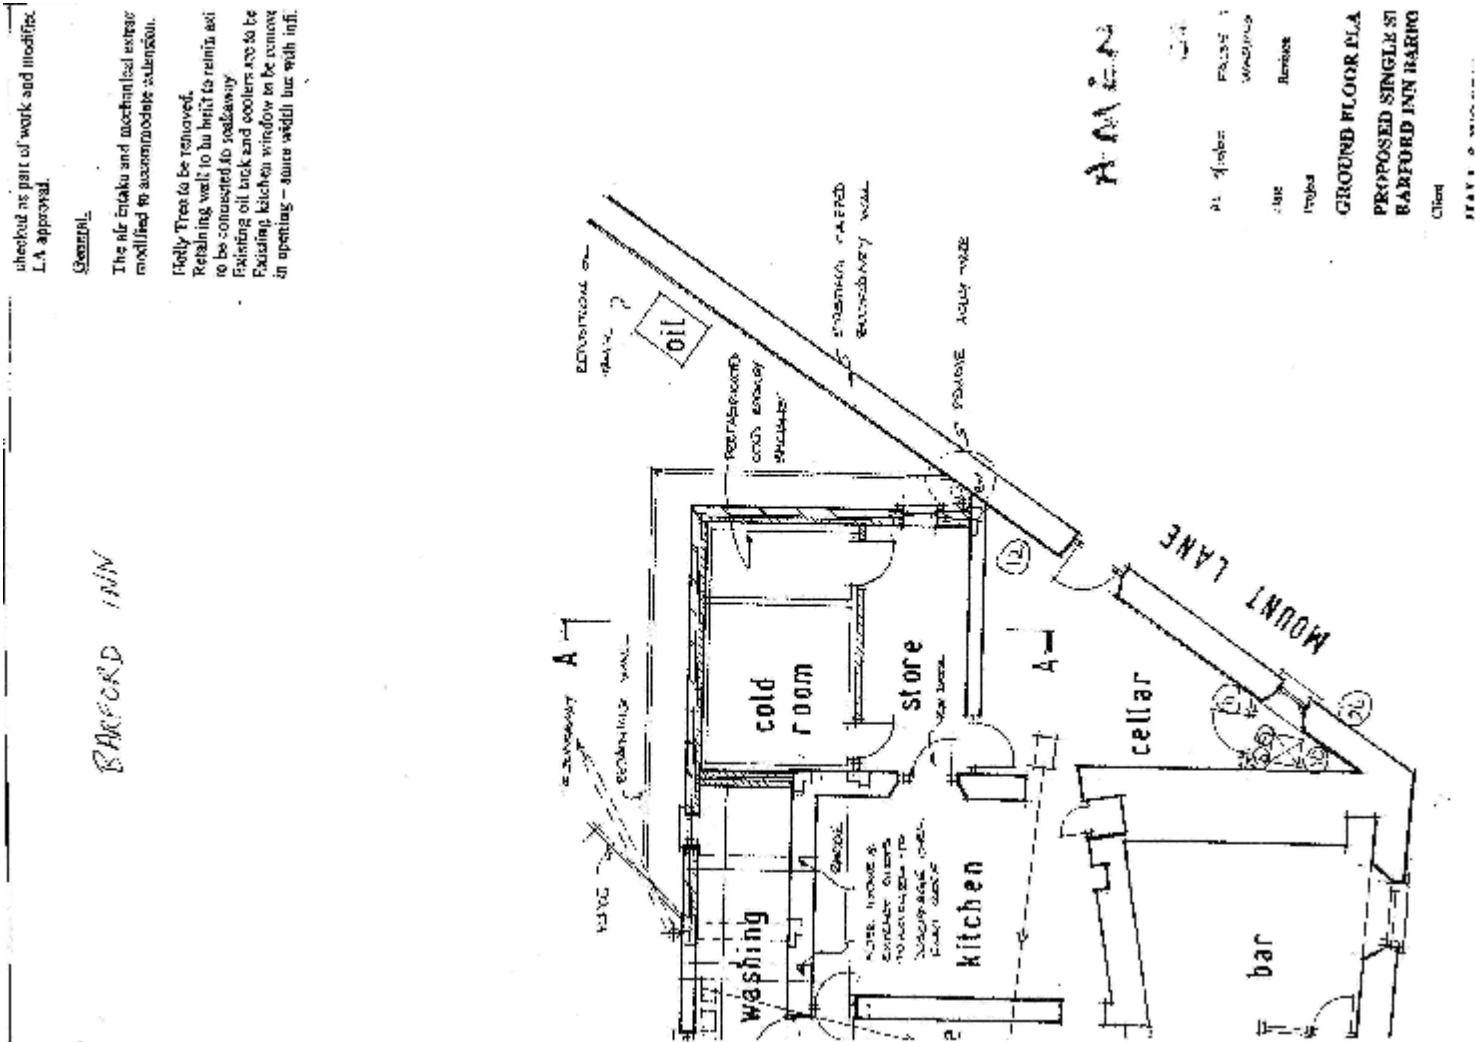

undertaken as part of work and modified.
 L.A. approval.

General:
 The air intake and mechanical extract
 modified to accommodate substrate.
 Folly Trees to be removed.
 Retaining wall to be built to retain and
 to be constructed to roadway.
 Replacing oil brick and coolers are to be
 Replacing kitchen window to be removed
 in opening - source within the wall infill.

Description of Drawing:
 Ground floor layout 2

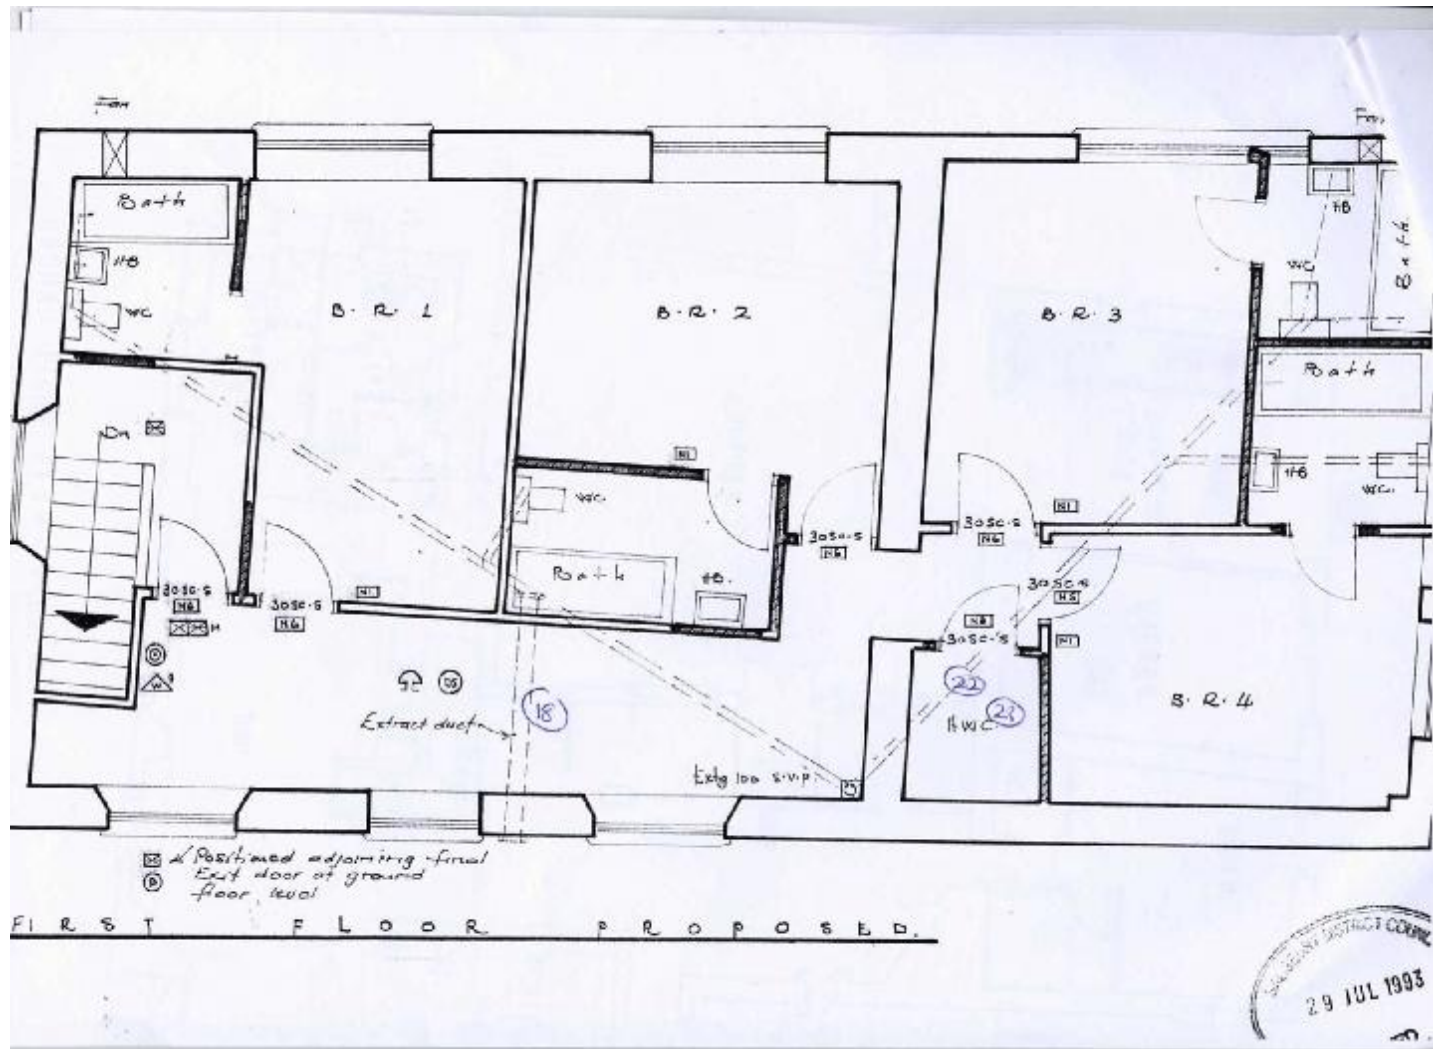

Description of Drawing:
First floor layout - annexe

SECTION THREE

SURVEY OBJECTIVES

JTEC Environmental Ltd.

Survey Objectives

- 1 Produce a report, in a database format, indicating areas containing identified and suspected asbestos based materials, including photographic records of asbestos occurrences where possible.
- 2 To carry out a survey to ascertain the presence of asbestos based materials.
- 3 To include a risk assessment for each individual Sample.

Client Name:	Hall & Woodhouse Ltd	Project Number:	AS05011 - Barford inn
		Survey Date:	17 January 2005
Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Printed On:	02 November 2008
		Survey Objectives:	Page 1 of 1

SECTION FOUR

SURVEY TECHNIQUE

JTEC Environmental Ltd.

Survey Technique

- 1 Materials of a similar type were only occasionally sampled and it was assumed that other surfaces identical to where the sample was taken, was of a similar composition.
- 2 Photographs were taken at all of the sample locations (unless otherwise stated).
- 3 Samples were returned to the Main Laboratory for analysis.
- 4 Asbestos Bulk Sample Analysis is conducted by using Polarised Light and Dispersion Staining Techniques. Dispersion Staining is used to describe the colour effects produced when a transparent colourless particle or fibre is immersed in a liquid having a refractive index near to that of the particle or fibre, and is viewed under a microscope using transmitted white light (based on HSE Publication MDHS 77).

Client Name:	Hall & Woodhouse Ltd	Project Number:	AS05011 - Barford inn
		Survey Date:	17 January 2005
Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Printed On:	02 November 2008
		Survey Technique:	Page 1 of 1

SECTION FIVE

SURVEY CAVEAT

JTEC Environmental Ltd.

Survey Caveat

- 1 This report is based upon a non-destructive inspection of an unfamiliar site. During the course of the survey all reasonable efforts were made to identify the physical presence of materials containing asbestos within the areas of the building which are subject to future refurbishment works. It is known that asbestos materials are frequently concealed within the fabric of buildings or within sealed building voids so that it is not possible to regard the findings of any survey as being definitive. It must always remain a possibility that further asbestos containing materials may be found during refurbishment or demolition activities. For reasons set out in this report, the results cannot give an assurance that all asbestos materials have been found and must not be thought to do so. The nature of the survey was a non-destructive inspection at key locations of accessible voids and areas. From the evidence of the inspections and of the sampling and analysis undertaken, it is clear that asbestos containing materials are either present or within or associated with various areas as detailed in the report. We recommend that samples be taken of suspect materials which may be uncovered within the listed areas or within the areas of the site which were not included in this survey.
- 2 From mid 2005, sample analysing laboratories do not provide information on the amounts of asbestos fibre present within materials as their UKAS or equivalent accreditation does not permit this. Therefore any reference to the concentrations of fibres that appear in any survey report are only approximations and are intended for guidance only.

Client Name:	Hall & Woodhouse Ltd	Project Number:	AS05011 - Barford inn
		Survey Date:	17 January 2005
Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Printed On:	02 November 2008
		Survey Caveat:	Page 1 of 1

SECTION SIX

SURVEY NOTES

JTEC Environmental Ltd.

Survey Notes

- 1 Whilst every effort was made to locate the ceiling panels, wall partitions and other panels, which may have been constructed from asbestos boarding, none other than those detailed were found. Some may have been missed due to repairs, alterations etc, where false and other finishes have been applied or where different specifications (including a possible mixture of asbestos and non-asbestos) panels have been used in the same area. Only by sampling each panel would the composition of all the materials be known. This was clearly not practical in terms of cost or time.
- 2 No air monitoring was carried out whilst the survey was undertaken and therefore care was taken not to cause disturbance of fibre or contamination of clean surfaces.
- 3 This report has been written with reference to the various Guidance Notes etc, issued, and current at the date of this report and describes circumstances at the site on the date the investigation took place.
- 4 Where similar items exist in the building, only one or two samples have been taken to ascertain the material content. It was assumed that similar products were of the same material. Only random sampling was carried out.
- 5 Any person undertaking work within the buildings should be told of the presence of asbestos. This briefing also applies to any other person associated with the site, including staff, sub-contractors and others.
- 6 The diagrams in the report are not to scale and are illustrative only to indicate approximate locations. The descriptions used are for location identification purposes
- 7 All the recommendations described in this report are based upon assumptions made after consideration of the type of material, condition of the material, its location, analysis result and type of use the area is thought to be subjected to. However, statutory authorities or others, could require amendments based on local knowledge, change in legislation, change in use or indeed, other conditions of criteria.
- 8 Equipment, machinery, ducting etc were not moved, opened up or examined for the purpose of this investigation except in the odd occasion where hatches were available.
- 9 It should be presumed that any firedoors contain asbestos unless otherwise indicated. It should also be presumed that structural firebreaks exist in the vicinity of a firedoor which are also likely to contain asbestos unless otherwise indicated.
In the event of damage or exposure of fireproof material within any fire door, separate samples should be taken and identified accordingly.
- 10 For further guidance on licenced and unlicenced work with Asbestos Containing Materials, the HSE website provides up to date information within the Asbestos Essentials section (www.hse.gov.uk/asbestos/essentials/).

Client Name:	Hall & Woodhouse Ltd	Project Number:	AS05011 - Barford inn
		Survey Date:	17 January 2005
Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Printed On:	02 November 2008
		Survey Notes:	Page 1 of 1

SECTION SEVEN

SURVEY SUMMARY

JTEC Environmental Ltd.

Survey Summary

- 1 For positive identification of asbestos bearing materials please refer to the individual sample data sheets.
- 2 Due to the nature of usage of the buildings surveyed, sampling was restricted / limited in certain areas for both health and safety reasons and food hygiene reasons. Consequently where items are reported as suspected asbestos materials, these items should be treated as such until otherwise identified.
- 3 All sample reference numbers and photograph reference numbers have been annotated on the accompanying plans, whether asbestos materials or not. This is for clarification where non-asbestos materials may be difficult to identify. However it must be stressed that if during refurbishment / maintenance work a suspect material is identified which is not included in this register, disturbance should be stopped prior to identification.
- 4 This register has been compiled so as to allow information to be updated with relative ease. Any work involving the removal of asbestos materials identified within this register should be recorded and the information updated accordingly.
- 5 Although work with asbestos cement does not necessarily require a licensed contractor it is recommended that all work involving the disturbance of any asbestos material is undertaken using contractors licensed by the HSE. Although asbestos cement is a relatively low risk material, it must not be interfered with in any way; e.g. cutting, drilling etc. as this may lead to raised airborne fibre levels. Where possible / practicable asbestos cement materials should be labelled appropriately. If asbestos cement materials are damaged or in areas where abrasion is likely, they should be encapsulated or removed.
- 6 All Asbestos Insulation Board should be encapsulated and labelled. Where insulation board is likely to sustain damage it should be removed. All work involving the disturbance of Asbestos insulation board must be undertaken by a licensed contractor, this includes drilling, cutting, encapsulating etc. Where debris has been identified, access to the area should be restricted prior to decontamination or removal.

Client Name:	Hall & Woodhouse Ltd	Project Number:	AS05011 - Barford inn
		Survey Date:	17 January 2005
Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Printed On:	02 November 2008
		Survey Summary:	Page 1 of 1

SECTION EIGHT

SURVEY RECOMMENDATIONS

Survey Recommendations

1 Material Assessment and Algorithm

The material assessment is an assessment of the condition of the ACM, or the presumed ACM, and the likelihood of it releasing fibres in the event of it being disturbed in some way. This material assessment will give a good initial guide to the priority for management, as it will identify the materials, which will most readily release airborne fibres if disturbed. However, there are other factors to take into account when prioritising action.

MDHS100 recommends the use of an algorithm to carry out the material assessment, and contains an example. The algorithm is a numerical way of taking into account several influencing factors, giving each factor considered a score. These scores can then be totaled to give a material assessment score. The use of algorithms is not infallible, but the assessment process is clear for all to see, so if discrepancies arise, it should be possible to track back through the assessment process to find the root of the error. The algorithm shown in MDHS100 considers four parameters that determine the risk from ACM: that is the ability to release fibres if disturbed. These four parameters are:

Product type;
Extent of damage;
Surface treatment; and
Asbestos type

Each of the parameters is scored and added to give a total score between 2 and 12:

Materials with scores of 10 or more should be regarded as high risk with a significant potential to release fibres if disturbed;

Those with a score between 7 and 9 are regarded as medium risk;

Materials with a score between 5 and 6 are low risk; and

Scores of 4 or less are very low risk.

NADIS indicates a sample that having been analysed at the laboratory shows no sign of asbestos fibres being present within the sample (No Asbestos Discovered In Sample).

PRIORITY ASSESSMENT AND ALGORITHM

The material assessment identifies the high-risk materials, that is, those which will most readily release airborne fibres if disturbed. It does not automatically follow that those materials assigned the highest score in the material assessment will be the materials that should be given priority for remedial action. Management priority must be determined by carrying out a risk assessment which will also take into account factors such as:

Maintenance activity;
Occupant activity;
Likelihood of disturbance;
Human exposure potential.

THE RISK ASSESSMENT INCLUDES A MATERIAL ASSESSMENT AND A PRIORITY ASSESSMENT.

THE MATERIAL ASSESSMENT LOOKS AT THE TYPE AND CONDITION OF THE ACM AND THE EASE

Client Name:	Hall & Woodhouse Ltd	Project Number:	AS05011 - Barford inn
		Survey Date:	17 January 2005
Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Printed On:	02 November 2008
		Recommendation:	Page 1 of 3

Survey Recommendations

WITH WHICH IT WILL RELEASE FIBRES IF DISTURBED.

THE PRIORITY ASSESSMENT LOOKS AT THE LIKELIHOOD OF SOMEONE DISTURBING THE ACM.

The risk assessment can only be carried out with detailed knowledge of all the above. Although a surveyor may have some of the information which will contribute to the risk assessment and may be part of an assessment team, you, as the duty holder under the Control of Asbestos Regulations 2006, are required to make the risk assessment, using the information given in the survey report and your detailed knowledge of the activities carried out within your premises. The risk assessment will form the basis of the management plan, so it is important that it is accurate.

If the use of the area or location changes, the risk assessment should be updated accordingly to reflect the change of use and potential for either increased or decreased exposure to fibres.

MAINTENANCE ACTIVITY

The first and most important factor which must be taken into consideration is the level of maintenance activity likely to be taking place in an area. Maintenance trades such as plumbers and electricians are the group who the duty to manage is primarily trying to protect. There are two types of maintenance activity, planned and unplanned. Planned work can be assessed and carried out using procedures and controls to reduce exposure to asbestos. Unplanned work requires the situation to be dealt with as found and the controls that can be applied may be more limited. The frequency of maintenance activities also need to be taken into account in deciding what management action is appropriate.

OCCUPANT ACTIVITY

The activities carried out in an area will have an impact on the risk assessment. When carrying out a risk assessment the main type of use of an area and the activities taking place within it should be taken into account. For example a little used storeroom or an attic will rarely be accessed and so any asbestos is unlikely to be disturbed. At the other end of the scale, in a warehouse lined with asbestos insulating board panels, with frequent vehicular movements, the potential for disturbance of ACMs is reasonably high and this would be a significant factor in the risk assessment. As well as the normal everyday activities taking place in an area, any secondary activities will need to be taken into account.

LIKELIHOOD OF DISTURBANCE

The two factors that will determine the likelihood of disturbance are the extent or amount of the ACM and its accessibility/vulnerability. For example, asbestos soffits outdoors are generally inaccessible without the use of ladders or scaffolding, are unlikely to be disturbed. The asbestos cement roof of a hospital ward is also unlikely to be disturbed, but its extent would need to be taken into account in any risk assessment. However if the same ward had asbestos panels on the walls they would be much more likely to be disturbed by trolley/bed movements.

HUMAN EXPOSURE POTENTIAL

The human exposure potential depends on three factors: the number of occupants of an area, the frequency of use of the area, and the average time each area is in use. For example, a school boiler room is likely to be unoccupied, but may be visited daily for a few minutes. The potential for exposure is much less than say in a classroom lined with asbestos insulating board panelling, which is occupied daily for six hours by 30 pupils and a teacher.

PRIORITY ASSESSMENT ALGORITHMS

Client Name:	Hall & Woodhouse Ltd	Project Number:	AS05011 - Barford inn
		Survey Date:	17 January 2005
Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Printed On:	02 November 2008
		Recommendation:	Page 2 of 3

Survey Recommendations

Taking all these factors into account in a logical, consistent manner is difficult. Using an algorithm will help you to produce priority assessments that have taken the factors into account in a consistent way. The number of factors relevant at any one site needs to be carefully considered, as the more factors included in an algorithm, the lower the influence of the most important risk factors becomes, and this may produce anomalies. For this reason it is recommended that the number of factors that are scored is limited to four, the same as the number of factors in the material assessment. There is no single set of factors that can be recommended that will apply equally to all types of premises. Therefore four general headings have been used and one or more factors can be taken into account and averaged under each heading to suit the circumstances. If you choose to use more than one factor under a general heading, then average the scores under that heading, rounding up where necessary.

The scores from the material assessment (i.e. the condition of the ACM or presumed ACM) are added to the scores of the priority assessment (the likelihood of disturbance), to give the overall risk assessment. Risk assessment scores for different ACMs can then be compared to develop your action plan. In many circumstances the scores will be similar, making decisions more difficult. For example a boiler house with asbestos pipe work insulation in poor condition may get the same or similar risk assessment score to an office with asbestos insulating board in reasonably good condition. This is simply because the ACM in the boiler house received a higher score than the ACM in the office because the ACM in the boiler house was in poor condition. However, the priority assessment for the office will get a higher score than the boiler house since the office is occupied more often. Add the scores together for the material and priority assessments, and you get similar scores. If this is the case then you may decide that the office needs doing first because it is used daily. On the other hand you may decide that the poor condition of the ACM in the boiler house means that it should be done first. If the office was a classroom, the young age of the occupants may be a deciding factor. Algorithms are provided to help you, but they are best guesses and will often require you to make your own additional judgements.

Client Name:	Hall & Woodhouse Ltd	Project Number:	AS05011 - Barford inn
		Survey Date:	17 January 2005
Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Printed On:	02 November 2008
		Recommendation:	Page 3 of 3

SECTION NINE

MATERIAL ASSESSMENT: SUMMARY BY AREA

Material Assessment: Summary by Area

Site Name: Barford Inn,
 Project Number: AS05011 - Barford inn

Area: Not Applicable

Sample Date	Location Ref	Location ID	Drawing Reference	Floor	Room	Asbestos Type	Product Name	Material Risk Score	Material Risk Band	Priority Risk Score	Comments	Action	Survey Type
17/01/05	21	2402	21	External ground floor	Corridor	Amosite	Ceiling panels	6	Low Risk	4		Re-encapsulate and Apply Warning Labels	T 2
17/01/05	19	2400	19	External ground floor	External	Amosite	Cladding	7	Medium Risk	5		Requires the complete removal	T 2
17/01/05	22	2403	22	First floor	Boiler cupboard	Chrysotile	Boiler	3	Very Low Risk	2		Apply Warning Labels	T 2
17/01/05	23	2404	23	First floor	Boiler cupboard	Amosite	Ceiling panel	6	Low Risk	2		Re-encapsulate and Apply Warning Labels	T 2
17/01/05	18	2399	18	First floor	Corridor	Amosite	Beam cladding	5	Low Risk	3		Apply Warning Labels	T 2
17/01/05	3	2384	3	Ground floor	Bar area	Amosite	Stair Backing / Cladding	5	Low Risk	5		Apply Warning Labels	T 2
17/01/05	24	2405	24	Ground floor	Boiler cupboard	Amosite	Stair Backing / Cladding	8	Medium Risk	4		Requires the complete removal	T 2
17/01/05	8	2389	8	Ground floor	Boiler room	Chrysotile	Boiler	3	Very Low Risk	3		Apply Warning Labels	T 2
17/01/05	9	2390	9	Ground floor	Boiler room	Chrysotile	Flue	4	Very Low Risk	2		Apply Warning Labels	T 2
17/01/05	10	2391	10	Ground floor	Boiler room	NADIS	Ceiling panel	0	NADIS	N/A		No Action Required	T 2
17/01/05	11	2392	11	Ground floor	Boiler room	Amosite	Door panel	6	Low Risk	4		Re-encapsulate and Apply Warning Labels	T 2
17/01/05	12	2393	12	Ground floor	Cellar	Chrysotile	Fuse & Switchgear Flashguard	3	Very Low Risk	4		Apply Warning Labels	T 2
17/01/05	2	2383	2	Ground floor	Corridor	Amosite	Box panelling	5	Low Risk	4		Apply Warning Labels	T 2
17/01/05	16	2397	16	Ground floor	Corridor	Chrysotile	Fuse & Switchgear Flashguard	3	Very Low Risk	3		Apply Warning Labels	T 2
17/01/05	17	2398	17	Ground floor	Corridor	Amosite	Door panel	6	Low Risk	3		Re-encapsulate and Apply Warning Labels	T 2
17/01/05	5	2386	5	Ground floor	Garage(s)	Amosite	Ceiling	7	Medium Risk	7	Sample applies to beam cladding in addition to ceiling.	Encapsulate and Apply Warning Labels	T 2



Material Assessment: Summary by Area

Site Name: Barford Inn,
 Project Number: AS05011 - Barford inn

Area: Not Applicable

Sample Date	Location Ref	Location ID	Drawing Reference	Floor	Room	Asbestos Type	Product Name	Material Risk Score	Material Risk Band	Priority Risk Score	Comments	Action	Survey Type
17/01/05	7	2388	7	Ground floor	Office	Amosite	Ceiling & Beam Cladding	6	Low Risk	5		Apply Warning Labels	T 2
17/01/05	4	2385	4	Ground floor	Restaurant	Chrysotile	Textured coating	3	Very Low Risk	5		Apply Warning Labels	T 2
17/01/05	6	2387	6	Ground floor	Store Room	Amosite	Ceiling & Beam Cladding	6	Low Risk	6		Re-encapsulate and Apply Warning Labels	T 2
17/01/05	1	2382	1	Ground floor	WC	Amosite	Box panelling	5	Low Risk	3		Apply Warning Labels	T 2
17/01/05	26	2407	26	Roof level	External	Chrysotile	Flue	3	Very Low Risk	1		Apply Warning Labels	T 2
17/01/05	27	2408	27	Roof level	External	Chrysotile	Verge Undercloak	3	Very Low Risk	N/A	All verge undercloaking is presumed an ACM.	No Action Required	T 2
17/01/05	20	2401	20	Roof level	Flat roof area	Chrysotile	Roofing felt	2	Very Low Risk	1		No Action Required	T 2
17/01/05	25	2406	25	Roof level	Flat roof area	Chrysotile	Roofing felt	2	Very Low Risk	1		No Action Required	T 2
17/01/05	13	2394	13	Roof level	Loft space	Chrysotile	Roofing felt	2	Very Low Risk	1		No Action Required	T 2
17/01/05	14	2395	14	Roof level	Loft space	NADIS	Water Tank Cover	0	NADIS	N/A		No Action Required	T 2
17/01/05	15	2396	15	Roof level	Loft space	NADIS	Insulation	0	NADIS	N/A		No Action Required	T 2

SECTION TEN

MATERIAL ASSESSMENT (PHOTO)

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2382	Survey Type:	T 2
Location Ref:	1	Product Type:	Asbestos Insulating Board
Product:	Box panelling	Damage:	No visible damage
Area:	Not Applicable	Treatment:	AIB painted or encapsulated
Floor:	Ground floor	Asbestos Type:	Amosite
Room:	WC	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	1	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	19 July 2005		

Material Risk Score: 5

Material Risk Band: Low Risk

Priority Risk Score: 3

Action: Apply Warning Labels



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2383	Survey Type:	T 2
Location Ref:	2	Product Type:	Asbestos Insulating Board
Product:	Box panelling	Damage:	No visible damage
Area:	Not Applicable	Treatment:	AIB painted or encapsulated
Floor:	Ground floor	Asbestos Type:	Amosite
Room:	Corridor	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	2	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	19 July 2005		

Material Risk Score	5
Material Risk Band:	Low Risk
Priority Risk Score:	4

Action: Apply Warning Labels



Material Comments:



JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2384	Survey Type:	T 2
Location Ref:	3	Product Type:	Asbestos Insulating Board
Product:	Stair Backing / Cladding	Damage:	No visible damage
Area:	Not Applicable	Treatment:	AIB painted or encapsulated
Floor:	Ground floor	Asbestos Type:	Amosite
Room:	Bar area	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	3	Accessibility:	Easy Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	19 July 2005		

Material Risk Score	5
Material Risk Band:	Low Risk
Priority Risk Score:	5

Action: Apply Warning Labels



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2385	Survey Type:	T 2
Location Ref:	4	Product Type:	Decorative finishes
Product:	Textured coating	Damage:	Low damage: Scratches or marks
Area:	Not Applicable	Treatment:	Composite asbestos materials
Floor:	Ground floor	Asbestos Type:	Chrysotile
Room:	Restaurant	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	4	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	17 January 2006		

Material Risk Score	3
Material Risk Band:	Very Low Risk
Priority Risk Score:	5

Action: Apply Warning Labels



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: <input type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input type="text" value="AS05011 - Barford inn"/>

Location ID:	<input type="text" value="2386"/>	Survey Type:	<input type="text" value="T 2"/>						
Location Ref:	<input type="text" value="5"/>	Product Type:	<input type="text" value="Asbestos Insulating Board"/>						
Product:	<input type="text" value="Ceiling"/>	Damage:	<input type="text" value="Low damage: Scratches or marks"/>						
Area:	<input type="text" value="Not Applicable"/>	Treatment:	<input type="text" value="Unsealed AIB"/>						
Floor:	<input type="text" value="Ground floor"/>	Asbestos Type:	<input type="text" value="Amosite"/>						
Room:	<input type="text" value="Garage(s)"/>	Identification:	<input type="text" value="Identified"/>						
Surveyor Name:	<input type="text" value="J D Chilvers"/>	Quantity:	<input type="text"/>						
Drawing Ref:	<input type="text" value="5"/>	Accessibility:	<input type="text" value="Easy Accessibility"/>						
Asbestos ?	<input type="text" value="Yes"/>	<table border="0" style="width: 100%;"> <tr> <td style="width: 80%;">Material Risk Score</td> <td><input type="text" value="7"/></td> </tr> <tr> <td>Material Risk Band:</td> <td><input type="text" value="Medium Risk"/></td> </tr> <tr> <td>Priority Risk Score:</td> <td><input type="text" value="7"/></td> </tr> </table>		Material Risk Score	<input type="text" value="7"/>	Material Risk Band:	<input type="text" value="Medium Risk"/>	Priority Risk Score:	<input type="text" value="7"/>
Material Risk Score	<input type="text" value="7"/>								
Material Risk Band:	<input type="text" value="Medium Risk"/>								
Priority Risk Score:	<input type="text" value="7"/>								
Date:	<input type="text" value="17 January 2005"/>								
Next Inspection:	<input type="text" value="17 April 2005"/>								

Action:



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2387	Survey Type:	T 2
Location Ref:	6	Product Type:	Asbestos Insulating Board
Product:	Ceiling & Beam Cladding	Damage:	Low damage: Scratches or marks
Area:	Not Applicable	Treatment:	AIB painted or encapsulated
Floor:	Ground floor	Asbestos Type:	Amosite
Room:	Store Room	Identification:	Identified
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	6	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	19 July 2005		

Material Risk Score	6
Material Risk Band:	Low Risk
Priority Risk Score:	6

Action: Re-encapsulate and Apply Warning Labels



Material Comments:



JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2388	Survey Type:	T 2
Location Ref:	7	Product Type:	Asbestos Insulating Board
Product:	Ceiling & Beam Cladding	Damage:	Low damage: Scratches or marks
Area:	Not Applicable	Treatment:	AIB painted or encapsulated
Floor:	Ground floor	Asbestos Type:	Amosite
Room:	Office	Identification:	Strongly Presumed as previous sample
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	7	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	19 July 2005		

Material Risk Score	6
Material Risk Band:	Low Risk
Priority Risk Score:	5

Action: Apply Warning Labels



Material Comments:



JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2389	Survey Type:	T 2
Location Ref:	8	Product Type:	Gaskets
Product:	Boiler	Damage:	No visible damage
Area:	Not Applicable	Treatment:	Composite asbestos materials
Floor:	Ground floor	Asbestos Type:	Chrysotile
Room:	Boiler room	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	8	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	17 January 2006		

Material Risk Score	3
Material Risk Band:	Very Low Risk
Priority Risk Score:	3

Action: Apply Warning Labels



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address:	Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Client Name:	Hall & Woodhouse Ltd
		Project Number:	AS05011 - Barford inn

Location ID:	2390	Survey Type:	T 2
Location Ref:	9	Product Type:	Asbestos cement
Product:	Flue	Damage:	Low damage: Scratches or marks
Area:	Not Applicable	Treatment:	Asbestos cement sheets etc
Floor:	Ground floor	Asbestos Type:	Chrysotile
Room:	Boiler room	Identification:	Identified
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	9	Accessibility:	Easy Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	17 January 2006		

Material Risk Score:

Material Risk Band:

Priority Risk Score:

Action:



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2391	Survey Type:	T 2
Location Ref:	10	Product Type:	NADIS
Product:	Ceiling panel	Damage:	NADIS
Area:	Not Applicable	Treatment:	NADIS
Floor:	Ground floor	Asbestos Type:	NADIS
Room:	Boiler room	Identification:	Identified
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	10	Accessibility:	
Asbestos ?	No		
Date:	17 January 2005		
Next Inspection:	Not Applicable		

Material Risk Score	0
Material Risk Band:	NADIS
Priority Risk Score:	N/A

Action: No Action Required



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2392	Survey Type:	T 2
Location Ref:	11	Product Type:	Asbestos Insulating Board
Product:	Door panel	Damage:	Low damage: Broken edge boards
Area:	Not Applicable	Treatment:	AIB painted or encapsulated
Floor:	Ground floor	Asbestos Type:	Amosite
Room:	Boiler room	Identification:	Identified
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	11	Accessibility:	Easy Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	19 July 2005		

Material Risk Score: 6

Material Risk Band: Low Risk

Priority Risk Score: 4

Action: Re-encapsulate and Apply Warning Labels



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2393	Survey Type:	T 2
Location Ref:	12	Product Type:	Ropes and woven textiles
Product:	Fuse & Switchgear Flashguard	Damage:	No visible damage
Area:	Not Applicable	Treatment:	Composite asbestos materials
Floor:	Ground floor	Asbestos Type:	Chrysotile
Room:	Cellar	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	12	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	17 January 2006		

Material Risk Score	3
Material Risk Band:	Very Low Risk
Priority Risk Score:	4

Action: Apply Warning Labels



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2394	Survey Type:	T 2
Location Ref:	13	Product Type:	Roofing felts
Product:	Roofing felt	Damage:	No visible damage
Area:	Not Applicable	Treatment:	Resins
Floor:	Roof level	Asbestos Type:	Chrysotile
Room:	Loft space	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	13	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	17 January 2006		

Material Risk Score	2
Material Risk Band:	Very Low Risk
Priority Risk Score:	1

Action: No Action Required



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address:	Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Client Name:	Hall & Woodhouse Ltd
		Project Number:	AS05011 - Barford inn

Location ID:	2395	Survey Type:	T 2
Location Ref:	14	Product Type:	NADIS
Product:	Water Tank Cover	Damage:	NADIS
Area:	Not Applicable	Treatment:	NADIS
Floor:	Roof level	Asbestos Type:	NADIS
Room:	Loft space	Identification:	Identified
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	14	Accessibility:	
Asbestos ?	No		
Date:	17 January 2005		
Next Inspection:	Not Applicable		

Material Risk Score	0
Material Risk Band:	NADIS
Priority Risk Score:	N/A

Action:	No Action Required
---------	--------------------



Material Comments:	
--------------------	--

JTEC Environmental Ltd.

Material Assessment Record

Site Address:	Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Client Name:	Hall & Woodhouse Ltd
		Project Number:	AS05011 - Barford inn

Location ID:	2396	Survey Type:	T 2
Location Ref:	15	Product Type:	NADIS
Product:	Insulation	Damage:	NADIS
Area:	Not Applicable	Treatment:	NADIS
Floor:	Roof level	Asbestos Type:	NADIS
Room:	Loft space	Identification:	Identified
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	15	Accessibility:	
Asbestos ?	No		
Date:	17 January 2005		
Next Inspection:	Not Applicable		

Material Risk Score	0
Material Risk Band:	NADIS
Priority Risk Score:	N/A

Action:	No Action Required
---------	--------------------



Material Comments:	
--------------------	--

JTEC Environmental Ltd.

Material Assessment Record

Site Address: <input type="text" value="Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input type="text" value="AS05011 - Barford inn"/>

Location ID:	<input type="text" value="2397"/>	Survey Type:	<input type="text" value="T 2"/>						
Location Ref:	<input type="text" value="16"/>	Product Type:	<input type="text" value="Ropes and woven textiles"/>						
Product:	<input type="text" value="Fuse & Switchgear Flashguard"/>	Damage:	<input type="text" value="No visible damage"/>						
Area:	<input type="text" value="Not Applicable"/>	Treatment:	<input type="text" value="Composite asbestos materials"/>						
Floor:	<input type="text" value="Ground floor"/>	Asbestos Type:	<input type="text" value="Chrysotile"/>						
Room:	<input type="text" value="Corridor"/>	Identification:	<input type="text" value="Presumed"/>						
Surveyor Name:	<input type="text" value="J D Chilvers"/>	Quantity:	<input type="text"/>						
Drawing Ref:	<input type="text" value="16"/>	Accessibility:	<input type="text" value="Medium Accessibility"/>						
Asbestos ?	<input type="text" value="Yes"/>	<table border="0" style="width: 100%;"> <tr> <td style="width: 70%;">Material Risk Score</td> <td><input type="text" value="3"/></td> </tr> <tr> <td>Material Risk Band:</td> <td><input type="text" value="Very Low Risk"/></td> </tr> <tr> <td>Priority Risk Score:</td> <td><input type="text" value="3"/></td> </tr> </table>		Material Risk Score	<input type="text" value="3"/>	Material Risk Band:	<input type="text" value="Very Low Risk"/>	Priority Risk Score:	<input type="text" value="3"/>
Material Risk Score	<input type="text" value="3"/>								
Material Risk Band:	<input type="text" value="Very Low Risk"/>								
Priority Risk Score:	<input type="text" value="3"/>								
Date:	<input type="text" value="17 January 2005"/>								
Next Inspection:	<input type="text" value="17 January 2006"/>								
Action:	Apply Warning Labels								



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2398	Survey Type:	T 2
Location Ref:	17	Product Type:	Asbestos Insulating Board
Product:	Door panel	Damage:	Low damage: Scratches or marks
Area:	Not Applicable	Treatment:	AIB painted or encapsulated
Floor:	Ground floor	Asbestos Type:	Amosite
Room:	Corridor	Identification:	Identified
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	17	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	19 July 2005		

Material Risk Score	6
Material Risk Band:	Low Risk
Priority Risk Score:	3

Action: Re-encapsulate and Apply Warning Labels



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2399	Survey Type:	T 2
Location Ref:	18	Product Type:	Asbestos Insulating Board
Product:	Beam cladding	Damage:	No visible damage
Area:	Not Applicable	Treatment:	AIB painted or encapsulated
Floor:	First floor	Asbestos Type:	Amosite
Room:	Corridor	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	18	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	19 July 2005		

Material Risk Score	5
Material Risk Band:	Low Risk
Priority Risk Score:	3

Action: Apply Warning Labels



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: <input type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input type="text" value="AS05011 - Barford inn"/>

Location ID:	<input type="text" value="2400"/>	Survey Type:	<input type="text" value="T 2"/>						
Location Ref:	<input type="text" value="19"/>	Product Type:	<input type="text" value="Asbestos Insulating Board"/>						
Product:	<input type="text" value="Cladding"/>	Damage:	<input type="text" value="Medium damage: Breakage"/>						
Area:	<input type="text" value="Not Applicable"/>	Treatment:	<input type="text" value="AIB painted or encapsulated"/>						
Floor:	<input type="text" value="External ground floor"/>	Asbestos Type:	<input type="text" value="Amosite"/>						
Room:	<input type="text" value="External"/>	Identification:	<input type="text" value="Identified"/>						
Surveyor Name:	<input type="text" value="J D Chilvers"/>	Quantity:	<input type="text"/>						
Drawing Ref:	<input type="text" value="19"/>	Accessibility:	<input type="text" value="Easy Accessibility"/>						
Asbestos ?	<input type="text" value="Yes"/>	<table border="0" style="width: 100%;"> <tr> <td style="width: 70%;">Material Risk Score</td> <td><input type="text" value="7"/></td> </tr> <tr> <td>Material Risk Band:</td> <td><input type="text" value="Medium Risk"/></td> </tr> <tr> <td>Priority Risk Score:</td> <td><input type="text" value="5"/></td> </tr> </table>		Material Risk Score	<input type="text" value="7"/>	Material Risk Band:	<input type="text" value="Medium Risk"/>	Priority Risk Score:	<input type="text" value="5"/>
Material Risk Score	<input type="text" value="7"/>								
Material Risk Band:	<input type="text" value="Medium Risk"/>								
Priority Risk Score:	<input type="text" value="5"/>								
Date:	<input type="text" value="17 January 2005"/>								
Next Inspection:	<input type="text" value="17 April 2005"/>								

Action:



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2401	Survey Type:	T 2
Location Ref:	20	Product Type:	Roofing felts
Product:	Roofing felt	Damage:	No visible damage
Area:	Not Applicable	Treatment:	Resins
Floor:	Roof level	Asbestos Type:	Chrysotile
Room:	Flat roof area	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	20	Accessibility:	Difficult Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	17 January 2006		

Material Risk Score	2
Material Risk Band:	Very Low Risk
Priority Risk Score:	1

Action: No Action Required



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: <input type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input type="text" value="AS05011 - Barford inn"/>

Location ID:	<input type="text" value="2402"/>	Survey Type:	<input type="text" value="T 2"/>						
Location Ref:	<input type="text" value="21"/>	Product Type:	<input type="text" value="Asbestos Insulating Board"/>						
Product:	<input type="text" value="Ceiling panels"/>	Damage:	<input type="text" value="Low damage: Scratches or marks"/>						
Area:	<input type="text" value="Not Applicable"/>	Treatment:	<input type="text" value="AIB painted or encapsulated"/>						
Floor:	<input type="text" value="External ground floor"/>	Asbestos Type:	<input type="text" value="Amosite"/>						
Room:	<input type="text" value="Corridor"/>	Identification:	<input type="text" value="Strongly Presumed"/>						
Surveyor Name:	<input type="text" value="J D Chilvers"/>	Quantity:	<input type="text"/>						
Drawing Ref:	<input type="text" value="21"/>	Accessibility:	<input type="text" value="Medium Accessibility"/>						
Asbestos ?	<input type="text" value="Yes"/>	<table border="0" style="width: 100%;"> <tr> <td style="width: 70%;">Material Risk Score</td> <td><input type="text" value="6"/></td> </tr> <tr> <td>Material Risk Band:</td> <td><input type="text" value="Low Risk"/></td> </tr> <tr> <td>Priority Risk Score:</td> <td><input type="text" value="4"/></td> </tr> </table>		Material Risk Score	<input type="text" value="6"/>	Material Risk Band:	<input type="text" value="Low Risk"/>	Priority Risk Score:	<input type="text" value="4"/>
Material Risk Score	<input type="text" value="6"/>								
Material Risk Band:	<input type="text" value="Low Risk"/>								
Priority Risk Score:	<input type="text" value="4"/>								
Date:	<input type="text" value="17 January 2005"/>								
Next Inspection:	<input type="text" value="19 July 2005"/>								

Action:



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Client Name:	Hall & Woodhouse Ltd
		Project Number:	AS05011 - Barford inn

Location ID:	2403	Survey Type:	T 2
Location Ref:	22	Product Type:	Gaskets
Product:	Boiler	Damage:	No visible damage
Area:	Not Applicable	Treatment:	Composite asbestos materials
Floor:	First floor	Asbestos Type:	Chrysotile
Room:	Boiler cupboard	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	22	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	17 January 2006		

Material Risk Score: 3

Material Risk Band: Very Low Risk

Priority Risk Score: 2

Action: Apply Warning Labels



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2404	Survey Type:	T 2
Location Ref:	23	Product Type:	Asbestos Insulating Board
Product:	Ceiling panel	Damage:	Low damage
Area:	Not Applicable	Treatment:	AIB painted or encapsulated
Floor:	First floor	Asbestos Type:	Amosite
Room:	Boiler cupboard	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	23	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	19 July 2005		

Material Risk Score	6
Material Risk Band:	Low Risk
Priority Risk Score:	2

Action: Re-encapsulate and Apply Warning Labels



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Client Name:	Hall & Woodhouse Ltd
		Project Number:	AS05011 - Barford inn

Location ID:	2405	Survey Type:	T 2
Location Ref:	24	Product Type:	Asbestos Insulating Board
Product:	Stair Backing / Cladding	Damage:	Medium damage: Loose fibres
Area:	Not Applicable	Treatment:	Unsealed AIB
Floor:	Ground floor	Asbestos Type:	Amosite
Room:	Boiler cupboard	Identification:	Identified
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	24	Accessibility:	Easy Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	17 April 2005		

Material Risk Score	8
Material Risk Band:	Medium Risk
Priority Risk Score:	4

Action:	Requires the complete removal
---------	-------------------------------



Material Comments:	
--------------------	--

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2406	Survey Type:	T 2
Location Ref:	25	Product Type:	Roofing felts
Product:	Roofing felt	Damage:	No visible damage
Area:	Not Applicable	Treatment:	Resins
Floor:	Roof level	Asbestos Type:	Chrysotile
Room:	Flat roof area	Identification:	Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	25	Accessibility:	Medium Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	17 January 2006		

Material Risk Score	2
Material Risk Band:	Very Low Risk
Priority Risk Score:	1

Action: No Action Required



Material Comments:

JTEC Environmental Ltd.

Material Assessment Record

Site Address: Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB

Client Name: Hall & Woodhouse Ltd

Project Number: AS05011 - Barford inn

Location ID:	2407	Survey Type:	T 2
Location Ref:	26	Product Type:	Asbestos cement
Product:	Flue	Damage:	No visible damage
Area:	Not Applicable	Treatment:	Asbestos cement sheets etc
Floor:	Roof level	Asbestos Type:	Chrysotile
Room:	External	Identification:	Strongly Presumed
Surveyor Name:	J D Chilvers	Quantity:	
Drawing Ref:	26	Accessibility:	Difficult Accessibility
Asbestos ?	Yes		
Date:	17 January 2005		
Next Inspection:	17 January 2006		

Material Risk Score	3
Material Risk Band:	Very Low Risk
Priority Risk Score:	1

Action: Apply Warning Labels



Material Comments:



JTEC Environmental Ltd.

Material Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>	

Location ID:	<input style="width: 95%;" type="text" value="2408"/>	Survey Type:	<input style="width: 95%;" type="text" value="T 2"/>
Location Ref:	<input style="width: 95%;" type="text" value="27"/>	Product Type:	<input style="width: 95%;" type="text" value="Asbestos cement"/>
Product:	<input style="width: 95%;" type="text" value="Verge Undercloak"/>	Damage:	<input style="width: 95%;" type="text" value="No visible damage"/>
Area:	<input style="width: 95%;" type="text" value="Not Applicable"/>	Treatment:	<input style="width: 95%;" type="text" value="Asbestos cement sheets etc"/>
Floor:	<input style="width: 95%;" type="text" value="Roof level"/>	Asbestos Type:	<input style="width: 95%;" type="text" value="Chrysotile"/>
Room:	<input style="width: 95%;" type="text" value="External"/>	Identification:	<input style="width: 95%;" type="text" value="Strongly Presumed"/>
Surveyor Name:	<input style="width: 95%;" type="text" value="J D Chilvers"/>	Quantity:	<input style="width: 95%;" type="text" value=""/>
Drawing Ref:	<input style="width: 95%;" type="text" value="27"/>	Accessibility:	<input style="width: 95%;" type="text" value="Medium Accessibility"/>
Asbestos ?	<input style="width: 95%;" type="text" value="Yes"/>	Material Risk Score <input style="width: 95%;" type="text" value="3"/> Material Risk Band: <input style="width: 95%;" type="text" value="Very Low Risk"/> Priority Risk Score: <input style="width: 95%;" type="text" value="N/A"/>	
Date:	<input style="width: 95%;" type="text" value="17 January 2005"/>		
Next Inspection:	<input style="width: 95%;" type="text" value="17 January 2006"/>		
Action:	No Action Required		



Material Comments:	All verge undercloaking is presumed an ACM.
---------------------------	---

SECTION ELEVEN

BULK IDENTIFICATION REPORT

JTEC Environmental Ltd.

BULK IDENTIFICATION REPORT

Client:	Hall & Woodhouse Ltd	Date Samples Received:	17/01/2005
Client Address:	The Brewery, Blandford St Mary, Dorset, DT11 9LS	Date Samples Analysed:	02/02/2005
Site Address:	Barford Inn., Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB		
F.A.O:	James Overy	Page 1 of 1	

METHOD USED:

Samples of material referenced below, have been examined to determine the presence of asbestos fibres, using a method of polarising light microscopy and centre stop dispersion staining, based on H.S.E,s MDHS 77. NOTE: We cannot be held responsible for the accuracy and competence of samples taken by third parties. Under these circumstances we cannot be held responsible for the interpretation of the results shown.

Location Ref	Location ID	Sample Location	Fibre Type
5	2386	Ground floor, Garage(s), Ceiling	Amosite
6	2387	Ground floor, Store Room, Ceiling & Beam Cladding	Amosite
9	2390	Ground floor, Boiler room, Flue	Chrysotile
10	2391	Ground floor, Boiler room, Ceiling panel	NADIS
11	2392	Ground floor, Boiler room, Door panel	Amosite
14	2395	Roof level, Loft space, Water Tank Cover	NADIS
15	2396	Roof level, Loft space, Insulation	NADIS
17	2398	Ground floor, Corridor, Door panel	Amosite
19	2400	External ground floor, External, Cladding	Amosite
24	2405	Ground floor, Boiler cupboard, Stair Backing / Cladding	Amosite

REPORT RAISED BY:

Signed: Print:

SECTION TWELVE

PRIORITY ASSESSMENT: SUMMARY BY AREA

Priority Assessment: Summary by Area

Site Name: Barford Inn,

Project Number: AS05011 - Barford inn

Area: Not Applicable

Sample Date	Location Ref	Location ID	Drawing Reference	Floor	Room	Comments	Normal Occupant Activity	Likelihood Of Disturbance	Human Exposure Potential	Maintenance Activity	Risk Score
17/01/05	21	2402	21	External ground floor	Corridor		1	1	1	1	4
17/01/05	19	2400	19	External ground floor	External		1	1	1	2	5
17/01/05	22	2403	22	First floor	Boiler cupboard		0	1	1	0	2
17/01/05	23	2404	23	First floor	Boiler cupboard		0	1	1	0	2
17/01/05	18	2399	18	First floor	Corridor		1	1	1	0	3
17/01/05	3	2384	3	Ground floor	Bar area		1	1	2	1	5
17/01/05	24	2405	24	Ground floor	Boiler cupboard		0	2	1	1	4
17/01/05	8	2389	8	Ground floor	Boiler room		0	1	1	1	3
17/01/05	9	2390	9	Ground floor	Boiler room		0	1	1	0	2
17/01/05	11	2392	11	Ground floor	Boiler room		0	2	1	1	4
17/01/05	12	2393	12	Ground floor	Cellar		0	1	2	1	4
17/01/05	2	2383	2	Ground floor	Corridor		1	1	1	1	4
17/01/05	16	2397	16	Ground floor	Corridor		0	1	1	1	3
17/01/05	17	2398	17	Ground floor	Corridor		0	1	1	1	3
17/01/05	5	2386	5	Ground floor	Garage(s)		1	2	2	2	7
17/01/05	7	2388	7	Ground floor	Office		1	1	2	1	5
17/01/05	4	2385	4	Ground floor	Restaurant		1	1	2	1	5
17/01/05	6	2387	6	Ground floor	Store Room		1	2	2	1	6
17/01/05	1	2382	1	Ground floor	WC		0	1	1	1	3



Priority Assessment: Summary by Area

Site Name: Barford Inn,

Project Number: AS05011 - Barford inn

Area: Not Applicable

Sample Date	Location Ref	Location ID	Drawing Reference	Floor	Room	Comments	Normal Occupant Activity	Likelihood Of Disturbance	Human Exposure Potential	Maintenance Activity	Risk Score
17/01/05	26	2407	26	Roof level	External		0	1	0	0	1
17/01/05	27	2408	27	Roof level	External		0	0	0	0	0
17/01/05	20	2401	20	Roof level	Flat roof area		0	1	0	0	1
17/01/05	25	2406	25	Roof level	Flat roof area		0	1	0	0	1
17/01/05	13	2394	13	Roof level	Loft space		0	1	0	0	1

SECTION THIRTEEN

PRIORITY ASSESSMENT RECORD

JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 90%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 90%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 90%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	<input style="width: 85%;" type="text" value="2382"/>
Location Ref:	<input style="width: 85%;" type="text" value="1"/>
Product:	<input style="width: 85%;" type="text" value="Box panelling"/>
Area:	<input style="width: 85%;" type="text" value="Not Applicable"/>
Floor:	<input style="width: 85%;" type="text" value="Ground floor"/>
Room:	<input style="width: 85%;" type="text" value="WC"/>
Surveyor Name:	<input style="width: 85%;" type="text" value="J D Chilvers"/>
Drawing Ref:	<input style="width: 85%;" type="text" value="1"/>
Asbestos ?	<input style="width: 85%;" type="text" value="Yes"/>
Date:	<input style="width: 85%;" type="text" value="17 January 2005"/>



Priority Comments:

Priority Assessment Algorithm			
Assessment factor	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	1
Human Exposure Potential:			
Number of occupants:	1 to 3	1	
Frequency of use of area:	Daily	3	average
Average time area is in use:	<1 hour	0	1
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:	3
Material Assessment Score (supplied by surveyor):	Low Risk 5
Total of Material and Priority Assessment Scores:	8



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2383
Location Ref:	2
Product:	Box panelling
Area:	Not Applicable
Floor:	Ground floor
Room:	Corridor
Surveyor Name:	J D Chilvers
Drawing Ref:	2
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Low disturbance	1	average
Secondary activities for area:	Low disturbance	1	1
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	average 1
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	
Extent/Amount:	>10 to <=50 (m2 or pipe run)	2	
Human Exposure Potential:			
Number of occupants:	1 to 3	1	average 1
Frequency of use of area:	Daily	3	
Average time area is in use:	<1 hour	0	
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:	4
Material Assessment Score (supplied by surveyor):	Low Risk 5
Total of Material and Priority Assessment Scores:	9



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2384
Location Ref:	3
Product:	Stair Backing / Cladding
Area:	Not Applicable
Floor:	Ground floor
Room:	Bar area
Surveyor Name:	J D Chilvers
Drawing Ref:	3
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Low disturbance	1	average
Secondary activities for area:	Low disturbance	1	1
Likelihood Of Disturbance:			
Location:	Large rooms or well-ventilated areas	1	average
Accessibility:	Occasionally likely to be disturbed	1	
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	
Human Exposure Potential:			
Number of occupants:	>10	3	average
Frequency of use of area:	Daily	3	
Average time area is in use:	>1 to <3 hours	1	
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:		5
Material Assessment Score (supplied by surveyor):	Low Risk	5
Total of Material and Priority Assessment Scores:		10



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	<input style="width: 85%;" type="text" value="2385"/>
Location Ref:	<input style="width: 85%;" type="text" value="4"/>
Product:	<input style="width: 85%;" type="text" value="Textured coating"/>
Area:	<input style="width: 85%;" type="text" value="Not Applicable"/>
Floor:	<input style="width: 85%;" type="text" value="Ground floor"/>
Room:	<input style="width: 85%;" type="text" value="Restaurant"/>
Surveyor Name:	<input style="width: 85%;" type="text" value="J D Chilvers"/>
Drawing Ref:	<input style="width: 85%;" type="text" value="4"/>
Asbestos ?	<input style="width: 85%;" type="text" value="Yes"/>
Date:	<input style="width: 85%;" type="text" value="17 January 2005"/>



Priority Comments:

Priority Assessment Algorithm			
Assessment factor	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Low disturbance	1	average
Secondary activities for area:	Low disturbance	1	1
Likelihood Of Disturbance:			
Location:	Large rooms or well-ventilated areas	1	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	>50 m2 or >50 m pipe run	3	1
Human Exposure Potential:			
Number of occupants:	>10	3	
Frequency of use of area:	Daily	3	average
Average time area is in use:	>1 to <3 hours	1	2
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	Unlikely to be disturbed	0	1

Total Priority Assessment Score:	5
Material Assessment Score (supplied by surveyor):	Very Low Risk 3
Total of Material and Priority Assessment Scores:	8



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	<input style="width: 95%;" type="text" value="2386"/>
Location Ref:	<input style="width: 95%;" type="text" value="5"/>
Product:	<input style="width: 95%;" type="text" value="Ceiling"/>
Area:	<input style="width: 95%;" type="text" value="Not Applicable"/>
Floor:	<input style="width: 95%;" type="text" value="Ground floor"/>
Room:	<input style="width: 95%;" type="text" value="Garage(s)"/>
Surveyor Name:	<input style="width: 95%;" type="text" value="J D Chilvers"/>
Drawing Ref:	<input style="width: 95%;" type="text" value="5"/>
Asbestos ?	<input style="width: 95%;" type="text" value="Yes"/>
Date:	<input style="width: 95%;" type="text" value="17 January 2005"/>



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Low disturbance	1	average
Secondary activities for area:	Low disturbance	1	1
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	average
Accessibility:	Occasionally likely to be disturbed	1	
Extent/Amount:	>10 to <=50 (m2 or pipe run)	2	
Human Exposure Potential:			
Number of occupants:	1 to 3	1	average
Frequency of use of area:	Daily	3	
Average time area is in use:	>1 to <3 hours	1	
Maintenance Activity:			
Type of maintenance activity:	Medium disturbance	2	average
Frequency of maintenance activity	<=1 per year	1	2

Total Priority Assessment Score:	7
Material Assessment Score (supplied by surveyor):	Medium Risk 7
Total of Material and Priority Assessment Scores:	14



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2387
Location Ref:	6
Product:	Ceiling & Beam Cladding
Area:	Not Applicable
Floor:	Ground floor
Room:	Store Room
Surveyor Name:	J D Chilvers
Drawing Ref:	6
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Low disturbance	1	average
Secondary activities for area:	Low disturbance	1	1
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	average
Accessibility:	Occasionally likely to be disturbed	1	
Extent/Amount:	>10 to <=50 (m2 or pipe run)	2	
Human Exposure Potential:			
Number of occupants:	1 to 3	1	average
Frequency of use of area:	Daily	3	
Average time area is in use:	>1 to <3 hours	1	
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:	6
Material Assessment Score (supplied by surveyor):	Low Risk 6
Total of Material and Priority Assessment Scores:	12



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	<input style="width: 95%;" type="text" value="2388"/>
Location Ref:	<input style="width: 95%;" type="text" value="7"/>
Product:	<input style="width: 95%;" type="text" value="Ceiling & Beam Cladding"/>
Area:	<input style="width: 95%;" type="text" value="Not Applicable"/>
Floor:	<input style="width: 95%;" type="text" value="Ground floor"/>
Room:	<input style="width: 95%;" type="text" value="Office"/>
Surveyor Name:	<input style="width: 95%;" type="text" value="J D Chilvers"/>
Drawing Ref:	<input style="width: 95%;" type="text" value="7"/>
Asbestos ?	<input style="width: 95%;" type="text" value="Yes"/>
Date:	<input style="width: 95%;" type="text" value="17 January 2005"/>



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Low disturbance	1	average
Secondary activities for area:	Low disturbance	1	1
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	average
Accessibility:	Occasionally likely to be disturbed	1	
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	
Human Exposure Potential:			
Number of occupants:	1 to 3	1	average
Frequency of use of area:	Daily	3	
Average time area is in use:	>1 to <3 hours	1	
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:		5
Material Assessment Score (supplied by surveyor):	Low Risk	6
Total of Material and Priority Assessment Scores:		11



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	<input style="width: 95%;" type="text" value="2389"/>
Location Ref:	<input style="width: 95%;" type="text" value="8"/>
Product:	<input style="width: 95%;" type="text" value="Boiler"/>
Area:	<input style="width: 95%;" type="text" value="Not Applicable"/>
Floor:	<input style="width: 95%;" type="text" value="Ground floor"/>
Room:	<input style="width: 95%;" type="text" value="Boiler room"/>
Surveyor Name:	<input style="width: 95%;" type="text" value="J D Chilvers"/>
Drawing Ref:	<input style="width: 95%;" type="text" value="8"/>
Asbestos ?	<input style="width: 95%;" type="text" value="Yes"/>
Date:	<input style="width: 95%;" type="text" value="17 January 2005"/>



Priority Comments:

Priority Assessment Algorithm			
Assessment factor	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Confined spaces	3	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	Small items strings gaskets	0	1
Human Exposure Potential:			
Number of occupants:	1 to 3	1	
Frequency of use of area:	Weekly	2	average
Average time area is in use:	<1 hour	0	1
Maintenance Activity:			
Type of maintenance activity:	Minor disturbance	0	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:	3
Material Assessment Score (supplied by surveyor):	Very Low Risk 3
Total of Material and Priority Assessment Scores:	6



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2390
Location Ref:	9
Product:	Flue
Area:	Not Applicable
Floor:	Ground floor
Room:	Boiler room
Surveyor Name:	J D Chilvers
Drawing Ref:	9
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Confined spaces	3	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	1
Human Exposure Potential:			
Number of occupants:	1 to 3	1	
Frequency of use of area:	Weekly	2	average
Average time area is in use:	<1 hour	0	1
Maintenance Activity:			
Type of maintenance activity:	Minor disturbance	0	average
Frequency of maintenance activity	Unlikely to be disturbed	0	0

Total Priority Assessment Score:	2
Material Assessment Score (supplied by surveyor):	Very Low Risk 4
Total of Material and Priority Assessment Scores:	6



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2392
Location Ref:	11
Product:	Door panel
Area:	Not Applicable
Floor:	Ground floor
Room:	Boiler room
Surveyor Name:	J D Chilvers
Drawing Ref:	11
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Confined spaces	3	average 2
Accessibility:	Occasionally likely to be disturbed	1	
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	
Human Exposure Potential:			
Number of occupants:	1 to 3	1	average 1
Frequency of use of area:	Weekly	2	
Average time area is in use:	<1 hour	0	
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:	4
Material Assessment Score (supplied by surveyor):	Low Risk 6
Total of Material and Priority Assessment Scores:	10



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	<input style="width: 95%;" type="text" value="2393"/>
Location Ref:	<input style="width: 95%;" type="text" value="12"/>
Product:	<input style="width: 95%;" type="text" value="Fuse & Switchgear Flashguard"/>
Area:	<input style="width: 95%;" type="text" value="Not Applicable"/>
Floor:	<input style="width: 95%;" type="text" value="Ground floor"/>
Room:	<input style="width: 95%;" type="text" value="Cellar"/>
Surveyor Name:	<input style="width: 95%;" type="text" value="J D Chilvers"/>
Drawing Ref:	<input style="width: 95%;" type="text" value="12"/>
Asbestos ?	<input style="width: 95%;" type="text" value="Yes"/>
Date:	<input style="width: 95%;" type="text" value="17 January 2005"/>



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	average
Accessibility:	Occasionally likely to be disturbed	1	
Extent/Amount:	Small items strings gaskets	0	
Human Exposure Potential:			
Number of occupants:	1 to 3	1	average
Frequency of use of area:	Daily	3	
Average time area is in use:	>1 to <3 hours	1	
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:		4
Material Assessment Score (supplied by surveyor):	Very Low Risk	3
Total of Material and Priority Assessment Scores:		7



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	<input style="width: 95%;" type="text" value="2394"/>
Location Ref:	<input style="width: 95%;" type="text" value="13"/>
Product:	<input style="width: 95%;" type="text" value="Roofing felt"/>
Area:	<input style="width: 95%;" type="text" value="Not Applicable"/>
Floor:	<input style="width: 95%;" type="text" value="Roof level"/>
Room:	<input style="width: 95%;" type="text" value="Loft space"/>
Surveyor Name:	<input style="width: 95%;" type="text" value="J D Chilvers"/>
Drawing Ref:	<input style="width: 95%;" type="text" value="13"/>
Asbestos ?	<input style="width: 95%;" type="text" value="Yes"/>
Date:	<input style="width: 95%;" type="text" value="17 January 2005"/>



Priority Comments:

Priority Assessment Algorithm			
Assessment factor	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Large rooms or well-ventilated areas	1	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	>50 m2 or >50 m pipe run	3	1
Human Exposure Potential:			
Number of occupants:	1 to 3	1	
Frequency of use of area:	Infrequent	0	average
Average time area is in use:	<1 hour	0	0
Maintenance Activity:			
Type of maintenance activity:	Minor disturbance	0	average
Frequency of maintenance activity	Unlikely to be disturbed	0	0

Total Priority Assessment Score:	1
Material Assessment Score (supplied by surveyor):	Very Low Risk 2
Total of Material and Priority Assessment Scores:	3



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2397
Location Ref:	16
Product:	Fuse & Switchgear Flashguard
Area:	Not Applicable
Floor:	Ground floor
Room:	Corridor
Surveyor Name:	J D Chilvers
Drawing Ref:	16
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	average
Accessibility:	Occasionally likely to be disturbed	1	
Extent/Amount:	Small items strings gaskets	0	
Human Exposure Potential:			
Number of occupants:	1 to 3	1	average
Frequency of use of area:	Daily	3	
Average time area is in use:	<1 hour	0	
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:	3
Material Assessment Score (supplied by surveyor):	Very Low Risk
Total of Material and Priority Assessment Scores:	6



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2398
Location Ref:	17
Product:	Door panel
Area:	Not Applicable
Floor:	Ground floor
Room:	Corridor
Surveyor Name:	J D Chilvers
Drawing Ref:	17
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm			
Assessment factor	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	
Accessibility:	Occasionally likely to be disturbed	1	average
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	1
Human Exposure Potential:			
Number of occupants:	1 to 3	1	
Frequency of use of area:	Daily	3	average
Average time area is in use:	<1 hour	0	1
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:		3
Material Assessment Score (supplied by surveyor):	Low Risk	6
Total of Material and Priority Assessment Scores:		9



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>	

Location ID:	2399
Location Ref:	18
Product:	Beam cladding
Area:	Not Applicable
Floor:	First floor
Room:	Corridor
Surveyor Name:	J D Chilvers
Drawing Ref:	18
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Low disturbance	1	average
Secondary activities for area:	Low disturbance	1	1
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	1
Human Exposure Potential:			
Number of occupants:	1 to 3	1	
Frequency of use of area:	Daily	3	average
Average time area is in use:	<1 hour	0	1
Maintenance Activity:			
Type of maintenance activity:	Minor disturbance	0	average
Frequency of maintenance activity	Unlikely to be disturbed	0	0

Total Priority Assessment Score:	3
Material Assessment Score (supplied by surveyor):	Low Risk 5
Total of Material and Priority Assessment Scores:	8



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2400
Location Ref:	19
Product:	Cladding
Area:	Not Applicable
Floor:	External ground floor
Room:	External
Surveyor Name:	J D Chilvers
Drawing Ref:	19
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm			
Assessment factor	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Low disturbance	1	average
Secondary activities for area:	Low disturbance	1	1
Likelihood Of Disturbance:			
Location:	Outdoors	0	
Accessibility:	Easily disturbed	2	average
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	1
Human Exposure Potential:			
Number of occupants:	1 to 3	1	
Frequency of use of area:	Daily	3	average
Average time area is in use:	<1 hour	0	1
Maintenance Activity:			
Type of maintenance activity:	Medium disturbance	2	average
Frequency of maintenance activity	<=1 per year	1	2

Total Priority Assessment Score:	5
Material Assessment Score (supplied by surveyor):	Medium Risk 7
Total of Material and Priority Assessment Scores:	12



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>	

Location ID:	2401
Location Ref:	20
Product:	Roofing felt
Area:	Not Applicable
Floor:	Roof level
Room:	Flat roof area
Surveyor Name:	J D Chilvers
Drawing Ref:	20
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm			
Assessment factor	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Outdoors	0	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	>50 m2 or >50 m pipe run	3	1
Human Exposure Potential:			
Number of occupants:	None	0	
Frequency of use of area:	Infrequent	0	average
Average time area is in use:	<1 hour	0	0
Maintenance Activity:			
Type of maintenance activity:	Minor disturbance	0	average
Frequency of maintenance activity	Unlikely to be disturbed	0	0

Total Priority Assessment Score:	1
Material Assessment Score (supplied by surveyor):	Very Low Risk 2
Total of Material and Priority Assessment Scores:	3



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>	

Location ID:	2402
Location Ref:	21
Product:	Ceiling panels
Area:	Not Applicable
Floor:	External ground floor
Room:	Corridor
Surveyor Name:	J D Chilvers
Drawing Ref:	21
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Low disturbance	1	average
Secondary activities for area:	Low disturbance	1	1
Likelihood Of Disturbance:			
Location:	Outdoors	0	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	>10 to <=50 (m2 or pipe run)	2	1
Human Exposure Potential:			
Number of occupants:	1 to 3	1	
Frequency of use of area:	Daily	3	average
Average time area is in use:	<1 hour	0	1
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:	4
Material Assessment Score (supplied by surveyor):	Low Risk 6
Total of Material and Priority Assessment Scores:	10



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2403
Location Ref:	22
Product:	Boiler
Area:	Not Applicable
Floor:	First floor
Room:	Boiler cupboard
Surveyor Name:	J D Chilvers
Drawing Ref:	22
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	Small items strings gaskets	0	1
Human Exposure Potential:			
Number of occupants:	1 to 3	1	
Frequency of use of area:	Weekly	2	average
Average time area is in use:	<1 hour	0	1
Maintenance Activity:			
Type of maintenance activity:	Minor disturbance	0	average
Frequency of maintenance activity	Unlikely to be disturbed	0	0

Total Priority Assessment Score:	2
Material Assessment Score (supplied by surveyor):	Very Low Risk 3
Total of Material and Priority Assessment Scores:	5



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2404
Location Ref:	23
Product:	Ceiling panel
Area:	Not Applicable
Floor:	First floor
Room:	Boiler cupboard
Surveyor Name:	J D Chilvers
Drawing Ref:	23
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	average 1
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	
Human Exposure Potential:			
Number of occupants:	1 to 3	1	average 1
Frequency of use of area:	Weekly	2	
Average time area is in use:	<1 hour	0	
Maintenance Activity:			
Type of maintenance activity:	Minor disturbance	0	average
Frequency of maintenance activity	Unlikely to be disturbed	0	0

Total Priority Assessment Score:	2
Material Assessment Score (supplied by surveyor):	Low Risk 6
Total of Material and Priority Assessment Scores:	8



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2405
Location Ref:	24
Product:	Stair Backing / Cladding
Area:	Not Applicable
Floor:	Ground floor
Room:	Boiler cupboard
Surveyor Name:	J D Chilvers
Drawing Ref:	24
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Rooms up to 100 m2	2	average 2
Accessibility:	Easily disturbed	2	
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	
Human Exposure Potential:			
Number of occupants:	1 to 3	1	average 1
Frequency of use of area:	Weekly	2	
Average time area is in use:	<1 hour	0	
Maintenance Activity:			
Type of maintenance activity:	Low disturbance	1	average
Frequency of maintenance activity	<=1 per year	1	1

Total Priority Assessment Score:	4
Material Assessment Score (supplied by surveyor):	Medium Risk 8
Total of Material and Priority Assessment Scores:	12



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>	

Location ID:	2406
Location Ref:	25
Product:	Roofing felt
Area:	Not Applicable
Floor:	Roof level
Room:	Flat roof area
Surveyor Name:	J D Chilvers
Drawing Ref:	25
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Outdoors	0	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	>10 to <=50 (m2 or pipe run)	2	1
Human Exposure Potential:			
Number of occupants:	None	0	
Frequency of use of area:	Infrequent	0	average
Average time area is in use:	<1 hour	0	0
Maintenance Activity:			
Type of maintenance activity:	Minor disturbance	0	average
Frequency of maintenance activity	Unlikely to be disturbed	0	0

Total Priority Assessment Score:	1
Material Assessment Score (supplied by surveyor):	Very Low Risk 2
Total of Material and Priority Assessment Scores:	3



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2407
Location Ref:	26
Product:	Flue
Area:	Not Applicable
Floor:	Roof level
Room:	External
Surveyor Name:	J D Chilvers
Drawing Ref:	26
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm			
Assessment factor	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Outdoors	0	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	>10 to <=50 (m2 or pipe run)	2	1
Human Exposure Potential:			
Number of occupants:	None	0	
Frequency of use of area:	Infrequent	0	average
Average time area is in use:	<1 hour	0	0
Maintenance Activity:			
Type of maintenance activity:	Minor disturbance	0	average
Frequency of maintenance activity	Unlikely to be disturbed	0	0

Total Priority Assessment Score:	1
Material Assessment Score (supplied by surveyor):	Very Low Risk 3
Total of Material and Priority Assessment Scores:	4



JTEC Environmental Ltd.

Priority Assessment Record

Site Address: <input style="width: 95%;" type="text" value="Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB"/>	Client Name: <input style="width: 95%;" type="text" value="Hall & Woodhouse Ltd"/>
	Project Number: <input style="width: 95%;" type="text" value="AS05011 - Barford inn"/>

Location ID:	2408
Location Ref:	27
Product:	Verge Undercloak
Area:	Not Applicable
Floor:	Roof level
Room:	External
Surveyor Name:	J D Chilvers
Drawing Ref:	27
Asbestos ?	Yes
Date:	17 January 2005



Priority Comments:

Priority Assessment Algorithm	Variable(s) selected	Score for each	Overall score
Normal Occupant Activity:			
Main type of activity in area:	Rare disturbance	0	average
Secondary activities for area:	Rare disturbance	0	0
Likelihood Of Disturbance:			
Location:	Outdoors	0	
Accessibility:	Usually inaccessible or unlikely to be disturbed	0	average
Extent/Amount:	<=10 m2 or <=10 m pipe run	1	0
Human Exposure Potential:			
Number of occupants:	None	0	
Frequency of use of area:	Infrequent	0	average
Average time area is in use:	<1 hour	0	0
Maintenance Activity:			
Type of maintenance activity:	Minor disturbance	0	average
Frequency of maintenance activity	Unlikely to be disturbed	0	0

Total Priority Assessment Score:	0
Material Assessment Score (supplied by surveyor):	Very Low Risk 3
Total of Material and Priority Assessment Scores:	3



SECTION FOURTEEN

EXCLUDED AREAS

JTEC Environmental Ltd.

Excluded Areas

1 Managers flat

Client Name:	Hall & Woodhouse Ltd	Project Number:	AS05011 - Barford inn
		Survey Date:	17 January 2005
Site Address:	Barford Inn,, Grovely Road, Barford St Martin, Salisbury, Wiltshire, SP3 4AB	Printed On:	02 November 2008
		Excluded Areas:	Page 1 of 1